

NOTE REQUIRED:
CONCRETE STRENGTH TEST MAY BE
REQUIRED FOR ALL Poured IN
PLACE CONCRETE.


REFER TO FULTON COUNTY STANDARD 401
OR RIP RAP SPECIFICATIONS.

NOTES:
WHERE SEWER PIPES RUN PARALLEL WITH CREEKS OR
STREAMS, RIP RAP IS REQUIRED WITHIN 10 FEET SEWER
EASEMENT. ALL SEWER OUTFALLS MUST BE LEFT ACCESSIBLE
TO COUNTY SERVICE TRUCKS.


GATES (12 FEET) WILL BE REQUIRED ON FENCES ACROSS
OUTFALLS HAVING A DIAMETER OF 12" OR LARGER.

STEEL PIPE COATED INSIDE AND COATED AND WRAPPED OUTSIDE MAY BE USED.

NOTE:
THE UNION OF UNLIKE PIPE (D.I.P., CLAY, P.V.C. OR
CONCRETE) SHALL BE JOINED TOGETHER WITH A
CONCRETE COLLAR AS SHOWN ABOVE AND
FLEXIBLE NEOPRENE COUPLING WITH STAINLESS
STEEL BANDS AND SHEAR RING.

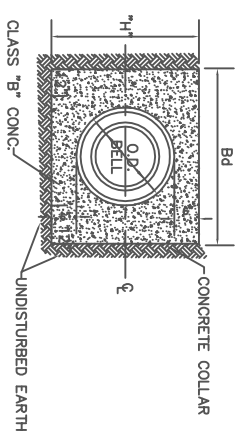


SECTION B-B
N.T.S.

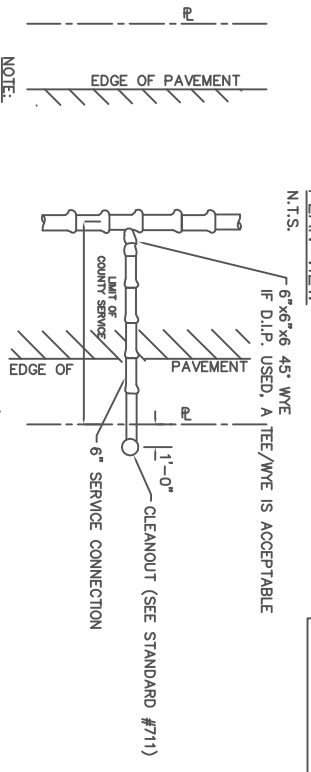

PLAN VIEW
N.T.S.

NOTE:
WHERE SERVICE LINE CROSSES STATE HWY. R/W, PIPE AND FITTINGS SHALL
BE MECHANICAL JOINT D.I. PIPE, AS SPECIFIED UNDER ITEM NO. 7 D.I. PIPE
AND TRENCH SHALL BE BACKFILLED WITH CRUSHED STONE.

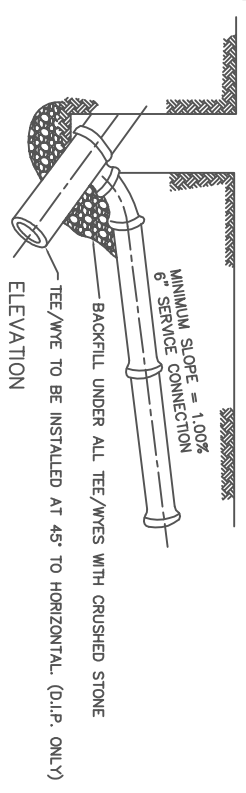

TYPICAL SERVICE CONNECTION
N.T.S.

FULTON COUNTY STANDARD DETAIL 118
PIPE SEWER DATA

DATE	REVISIONS	DATE	REVISIONS	DGS/DRN/CHKD. REB	APPROVED: REV	DATE	FULTON COUNTY	FULTON COUNTY PUBLIC WORKS	DRAWING NO.
8/08	NRR					12-2-05		141 PRYOR ST. ATLANTA, GA. 30303	118
								404-612-7400 FAX: 404-224-0498	