


NOTES:

1. CONNECTIONS TO NEW SEWER SHALL BE WITH A WYE.
2. NO TEES WILL BE ALLOWED.
3. NO TEE OR WYE CONNECTIONS WILL BE ALLOWED ON EXISTING SEWERS LARGER THAN 12"Ø.
4. ALL CONNECTIONS TO EXISTING SEWERS SHALL BE MADE WITH A WYE.
5. WHERE SERVICE LINE CROSSES STATE HWY R/W, PIPE AND FITTINGS SHALL BE MECHANICAL JOINT D.I. PIPE AS SPECIFIED UNDER ITEM NO. 7 D.I. PIPE AND TRENCH SHALL BE BACKFILLED WITH CRUSHED STONE.

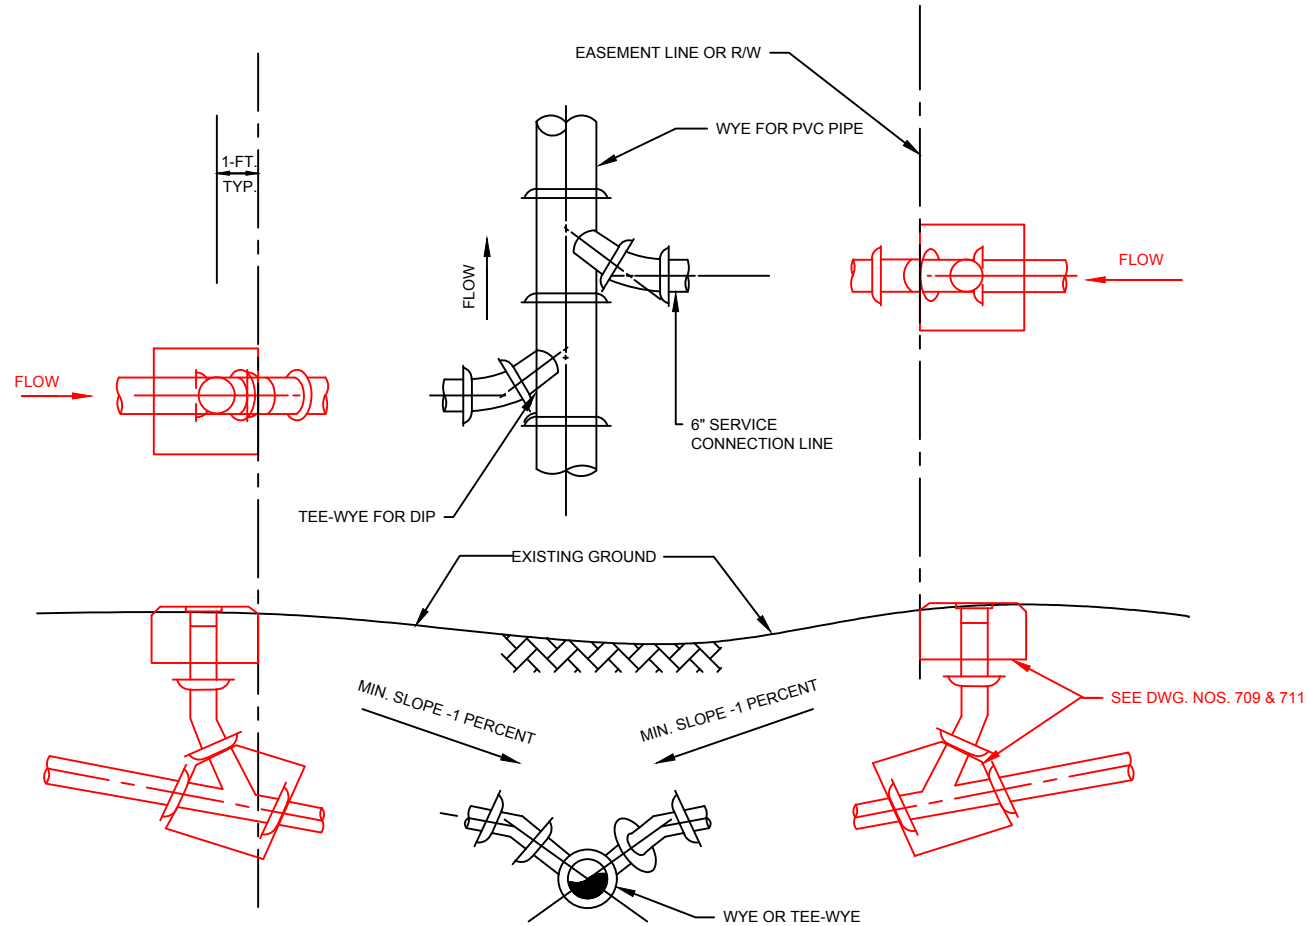

FULTON COUNTY STANDARD DETAIL 707
SERVICE CONNECTION ON NEW SEWERS

DATE	REVISIONS	DATE	REVISIONS
8/08	NRR		
3/17	TPM		

DGS/DRN/CHKD: JM
APPROVED: REW
DATE: 12-2-05



FULTON COUNTY PUBLIC WORKS
141 PRYOR ST. ATLANTA, GA. 30303
404-612-7400 FAX: 404-224-0498

DRAWING NO.
707